



FRONT ELEVATION

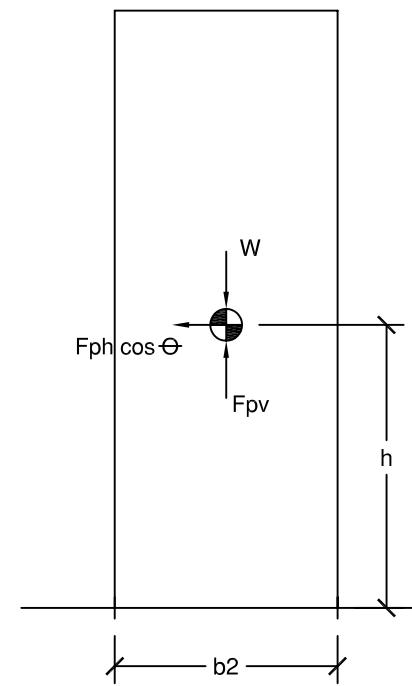


SIDE ELEVATION

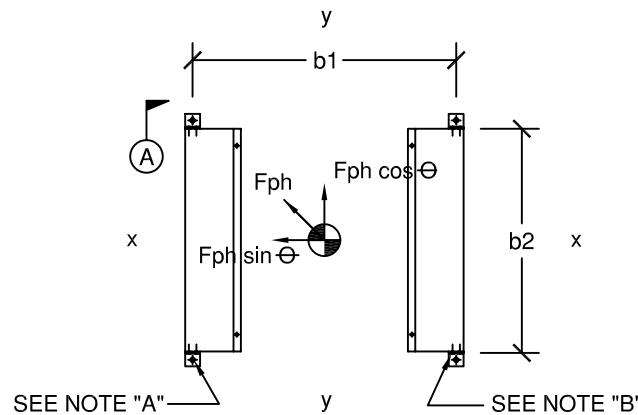

PLAN VIEW OF MOUNTING HOLE LOCATION

NOTE "A": (1) 1/2" DIA. HILTI KB-TZ PER ANGLE BRACKET W/ 2-5/8" EMBED.
NOTE "B": (2) #12 SELF-TAPPING SCREW PER ANGLE @ 1" O.C.

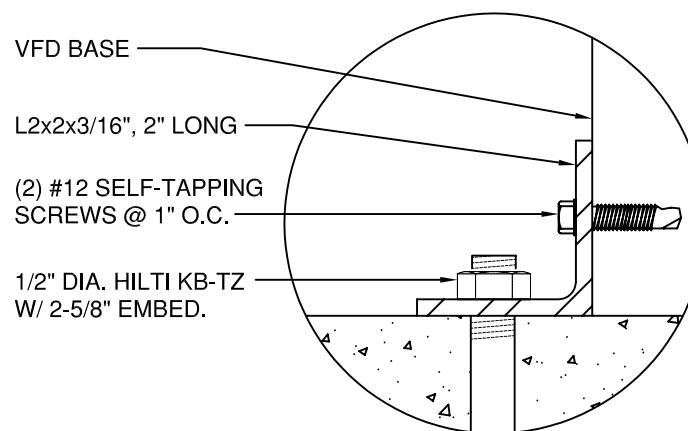

DETAIL A

Project:
Customer:
Date:



Tag:

A. PALMA
engineering

Equipment overturning calculations based on seismic load applied at a critical angle:

OPERATING WEIGHT: $W := 900 \text{ lb}$

The following plan dimensions are as follows. Refer to attach plan view and elevation drawings.

$$b1 := 34.00 \text{ in}$$

$$b2 := 30.00 \text{ in}$$

$$h_{cg} := 46.00 \text{ in}$$

$N := 4$ Number of angle brackets.

SEISMIC CRITERIA PER 2007 CBC & ASCE 7-05: Occupancy Category III, Site Class D

$$S_s := 1.50 \quad \text{Mapped spectral accelerations for short periods}$$

$$F_a := 1.00 \quad \text{Site coefficient}$$

$$S_{MS} := F_a \cdot S_s \quad \text{MCE spectral response acceleration for short periods}$$

$$S_{DS} := \frac{2}{3} \cdot S_{MS} \quad \text{Spectral acceleration, short period}$$

$$z := 0.0 \quad \text{Height in structure of point of attachment of component w/ respect to the base}$$

$$h := 1.0 \quad \text{Average roof height of structure w/ respect to base}$$

$$I_p := 1.0 \quad \text{Component importance factor}$$

$$a_p := 2.5 \quad \text{Component amplification factor}$$

$$R_p := 6.0 \quad \text{Component response modification factor}$$

$$F_p := \frac{0.4 \cdot a_p \cdot S_{DS} \cdot W}{\frac{R_p}{I_p}} \cdot \left(1 + 2 \cdot \frac{z}{h} \right) \quad F_p = 150 \text{ lb}$$

shall not be greater than:

$$F_{pmax} := 1.6 \cdot W \cdot I_p \cdot S_{DS} \quad F_{pmax} = 1440 \text{ lb}$$

and shall not be less than:

$$F_{pmin} := 0.3 \cdot W \cdot I_p \cdot S_{DS} \quad F_{pmin} = 270 \text{ lb} \quad \text{Governs!}$$

Project:
Customer:
Date:



Tag:

A. PALMA
engineering

$$F_{ph} := \frac{F_{pmin}}{1.4} \quad F_{ph} = 193 \text{ lb}$$

Vertical seismic load:

$$F_{pv} := 0.2 \cdot S_{DS} \cdot W \quad F_{pv} = 180 \text{ lb}$$

Consider the load applied in any horizontal direction. Refer to elevation drawing attached.

The Transverse Component = $F_{ph} \cos(\theta)$

The Longitudinal Component = $F_{ph} \sin(\theta)$

The uplift load on angle no. 4:

$$P_t = \frac{0.9W - F_{pv}}{N} - \frac{F_{ph} \cdot \cos(\theta) \cdot h_{cg} \cdot \frac{b2}{2}}{I_{yy}} - \frac{F_{ph} \cdot \sin(\theta) \cdot h_{cg} \cdot \frac{b1}{2}}{I_{xx}}$$

The compressive load on angle no. 1:

$$P_c = \frac{0.9W + F_{pv}}{N} - \frac{F_{ph} \cdot \cos(\theta) \cdot h_{cg} \cdot \frac{b2}{2}}{I_{yy}} + \frac{F_{ph} \cdot \sin(\theta) \cdot h_{cg} \cdot \frac{b1}{2}}{I_{xx}}$$

where,

$$I_{xx} := \frac{N \cdot (N + 2) \cdot b1^2}{12 \cdot (N - 2)}$$

$$I_{xx} = 1156 \text{ in}^2$$

$$I_{yy} := \frac{N \cdot b2^2}{4}$$

$$I_{yy} = 900 \text{ in}^2$$

To maximize the values,

$$\frac{dP_t}{d\theta} = 0 \quad \text{and} \quad \frac{dP_c}{d\theta} = 0$$

Project:
Customer:
Date:



Tag:

A. PALMA
engineering

will yield a condition:

$$\theta := \text{atan}\left(\frac{I_{yy} \cdot b1}{I_{xx} \cdot b2}\right)$$

$$\theta = 41.42 \text{ deg}$$

CHECK ANCHOR ATTACHMENTS

Maximum Tension per angle:

$$P_t := \frac{0.9W - F_{pv}}{N} - \frac{F_{ph} \cdot \cos(\theta) \cdot h_{cg} \cdot \frac{b2}{2}}{I_{yy}} - \frac{F_{ph} \cdot \sin(\theta) \cdot h_{cg} \cdot \frac{b1}{2}}{I_{xx}}$$

$$P_t = -40 \text{ lb} \quad \text{UPLIFT}$$

Maximum Shear per angle:

$$P_s := \frac{F_{ph}}{N}$$

$$P_s = 48 \text{ lb}$$

Allowable load for #12 self tapping screw attached to min. 18 ga. enclosure per ICBO Report ER-5202:

$$n_s := 2 \quad \text{Number of screws per angle bracket.}$$

$$T_s := \frac{P_s}{n_s} \quad \text{Tension per screw.}$$

$$V_s := \frac{|P_s|}{n_s} \quad \text{Shear per screw.}$$

$$V_{allow} := 326 \cdot \text{lb} \quad > \quad V_s = 24 \text{ lb} \quad \text{Okay!}$$

$$T_{allow} := 141 \cdot \text{lb} \quad > \quad T_s = 24 \text{ lb} \quad \text{Okay!}$$

Project:
Customer:
Date:



Tag:

A. PALMA
engineering

Consider L2"x2"x3/16", 2" long:

b := 2.00in	<i>Length of angle.</i>
d := 0.1875in	<i>Thickness of angle.</i>
w_a := 2.00in	<i>Width of angle.</i>
h_a := 2.00in	<i>Height of angle.</i>
M := P_s · h_a	<i>Max. bending moment.</i>

$$s := \frac{b \cdot d^2}{6} \quad \text{Section modulus.}$$

$$f_b := \frac{M}{s} \quad \text{Bending stress.}$$

$$F_y := 36000 \text{ lb} \cdot \text{in}^{-2} \quad \text{Yield stress.}$$

$$F_b := 0.66 \cdot F_y \quad \text{Allowable stress.}$$

$$F_b = 23760 \text{ lb} \cdot \text{in}^{-2} \quad > \quad f_b = 8229 \text{ lb} \cdot \text{in}^{-2} \quad \underline{\text{Okay!}}$$

Transfer load to anchors:

$$T_a := \frac{|P_t| \cdot w_a + P_s \cdot h_a}{\frac{w_a}{2}} \quad \text{Tension per anchor.}$$

$$T_a = 176 \text{ lb}$$

$$V_a := P_s \quad \text{Shear per anchor.}$$

$$V_a = 48 \text{ lb}$$

Project:
Customer:
Date:



Tag:

A. PALMA
engineering

CHECK ANCHORS: Calculation per Tables 9 & 10 in ICC ES Report ESR-1917.

Consider 1/2" dia. Carbon Steel Hilti KB-TZ anchor w/ 2-5/8" embedment into 3000psi normal weight concrete.

Assumptions:

Edge Distance = 5.5" Minimum

Anchor Spacing = 5.75" Minimum

Concrete Thickness = 4.0" Minimum

CHECK COMBINED LOADING

$T_{allow} := 1167\text{lb}$

$V_{allow} := 2839\text{lb}$

$$\frac{T_a}{T_{allow}} + \frac{V_a}{V_{allow}} = 0.17 < 1.2 \quad \text{Okay!}$$